

Bidding Requirements, Contract Forms and Conditions of the Contract
ADDENDUM
Section 00900

ADDENDUM No. 5

Date **March 20, 2014**
City of Austin
Project Name **Seaholm Street Improvements**
C.I.P. No. **7328.006**

This Addendum forms a part of Contract and clarifies, corrects or modifies original Bid Documents, dated February 17, 2014. Acknowledge receipt of this addendum in space provided on bid form. Failure to do so may subject bidder to disqualification.

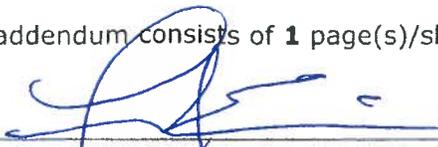
A. Project Manual Revisions: None

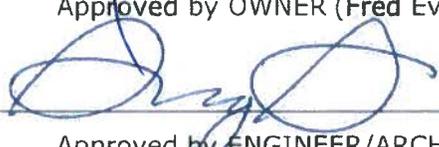
B. Drawing Revisions:

1. Add the following Note to Plan Sheet 16:

"Concrete shall have a minimum compressive strength of 4,000 PSI at 28 days using a minimum of 5.5 sacks of cement per cubic yard. Slump shall not exceed 6 inches. Control joints should be spaced a maximum of 20 feet on center. Reinforcing steel should consist of No. 3 bars on 18-inch centers or an equivalent wire mesh. Expansion joints should be reinforced with No 5 bars 18 inches long spaced at 16 inches."

This addendum consists of **1** page(s)/sheet(s).


Approved by OWNER (Fred Evins)


Approved by ENGINEER/ARCHITECT
(Gregory S. Strmiska)

END



3-20-14